

IN THE DRAWINGS

The Applicants have amended the drawings to correspond to the specification. Particularly, the Applicants have added several reference numerals to Figures 1, 2, and 3 and modified the reference numerals in Figures 5, 6C and 7 to correspond to the specification. Corrected Figures 1, 2, 3, 5, 6C and 7 showing these changes in red have been submitted for approval by the Examiner. None of the foregoing changes include any new matter.

It is respectfully asserted that the foregoing amendments place the application in better condition for examination, and that none of the foregoing changes contain any new matter.


The Commissioner is hereby authorized to charge any additional fees which may be required, or credit any overpayment to Deposit Account No. 07-1896.

Respectfully submitted,

GRAY CARY WARE & FREIDENRICH LLP

Dated: July 8, 2002

By



David Alberti  
Reg. No. 43,465  
Attorney for Applicants

GRAY CARY WARE & FREIDENRICH  
1755 Embarcadero Road  
Palo Alto, California 94303-3340  
Telephone: (650) 833-2052  
Facsimile: (650) 320-7401

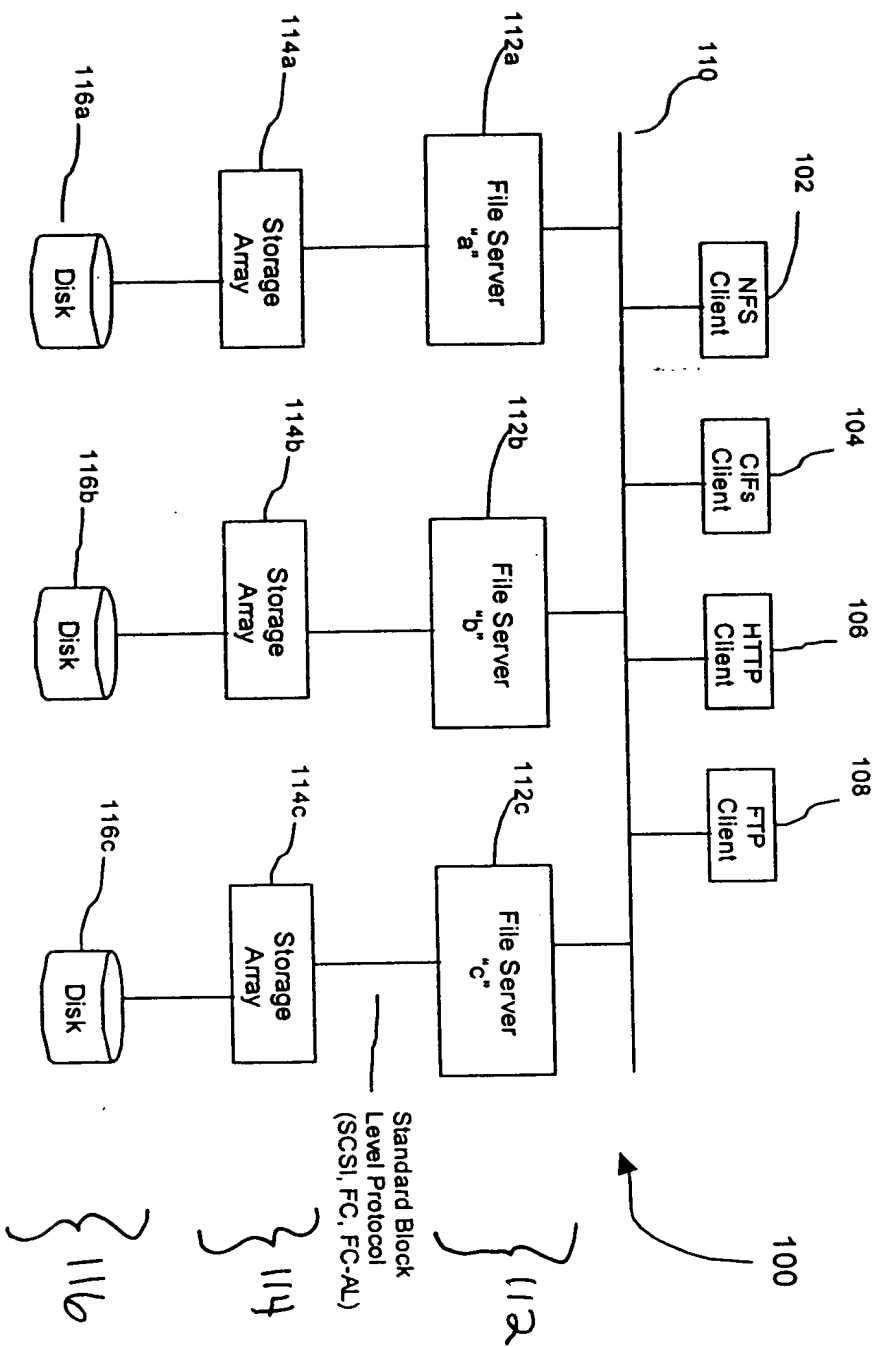


FIG. 1  
(Related Art)

09/731418

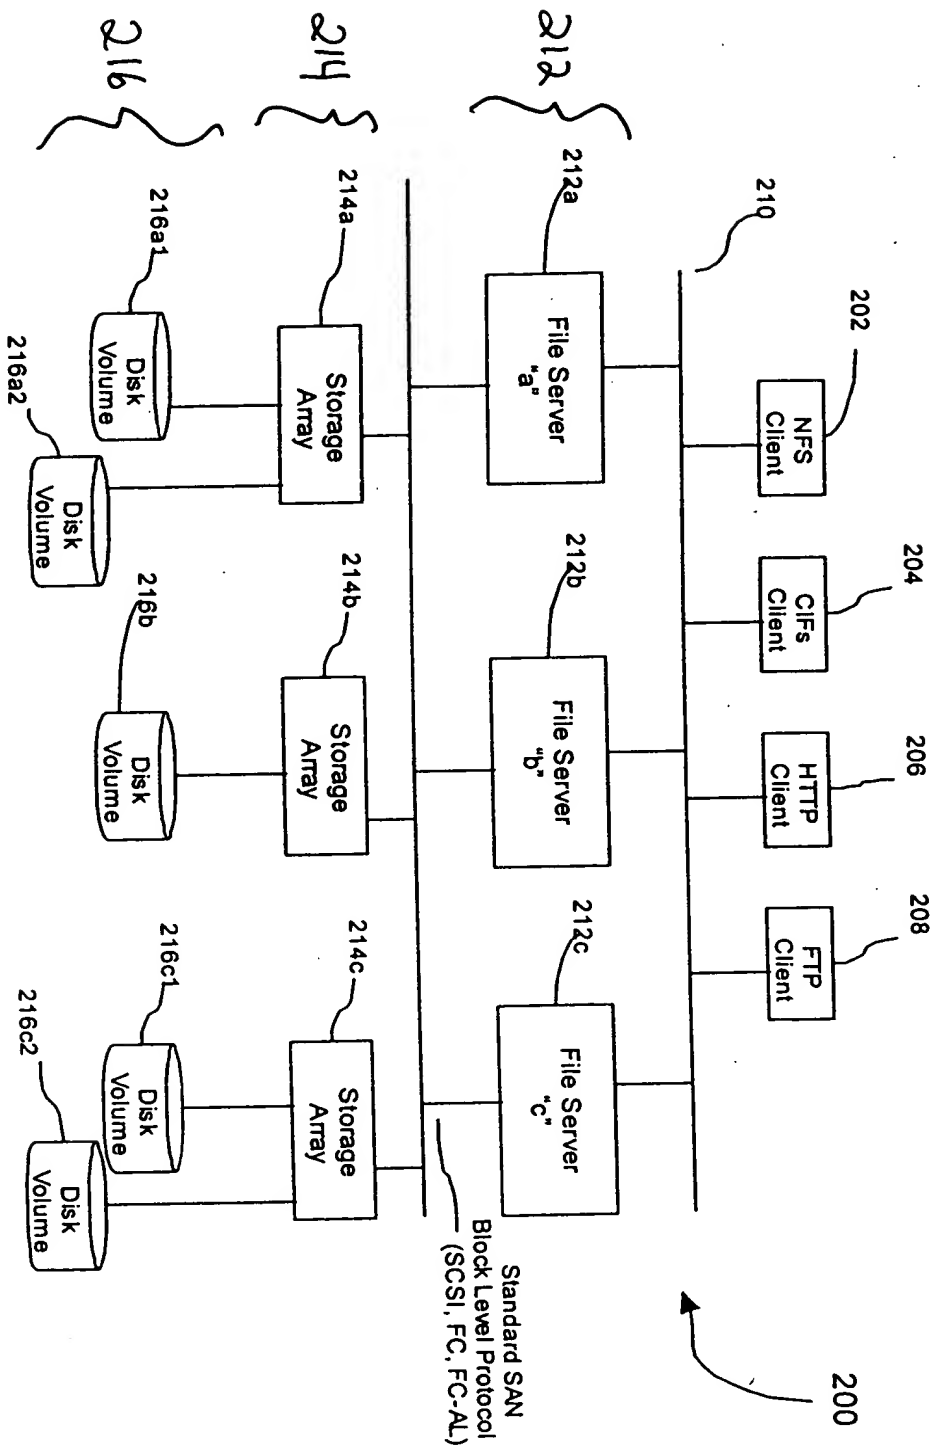


FIG. 2  
(Related Art)

09/731418

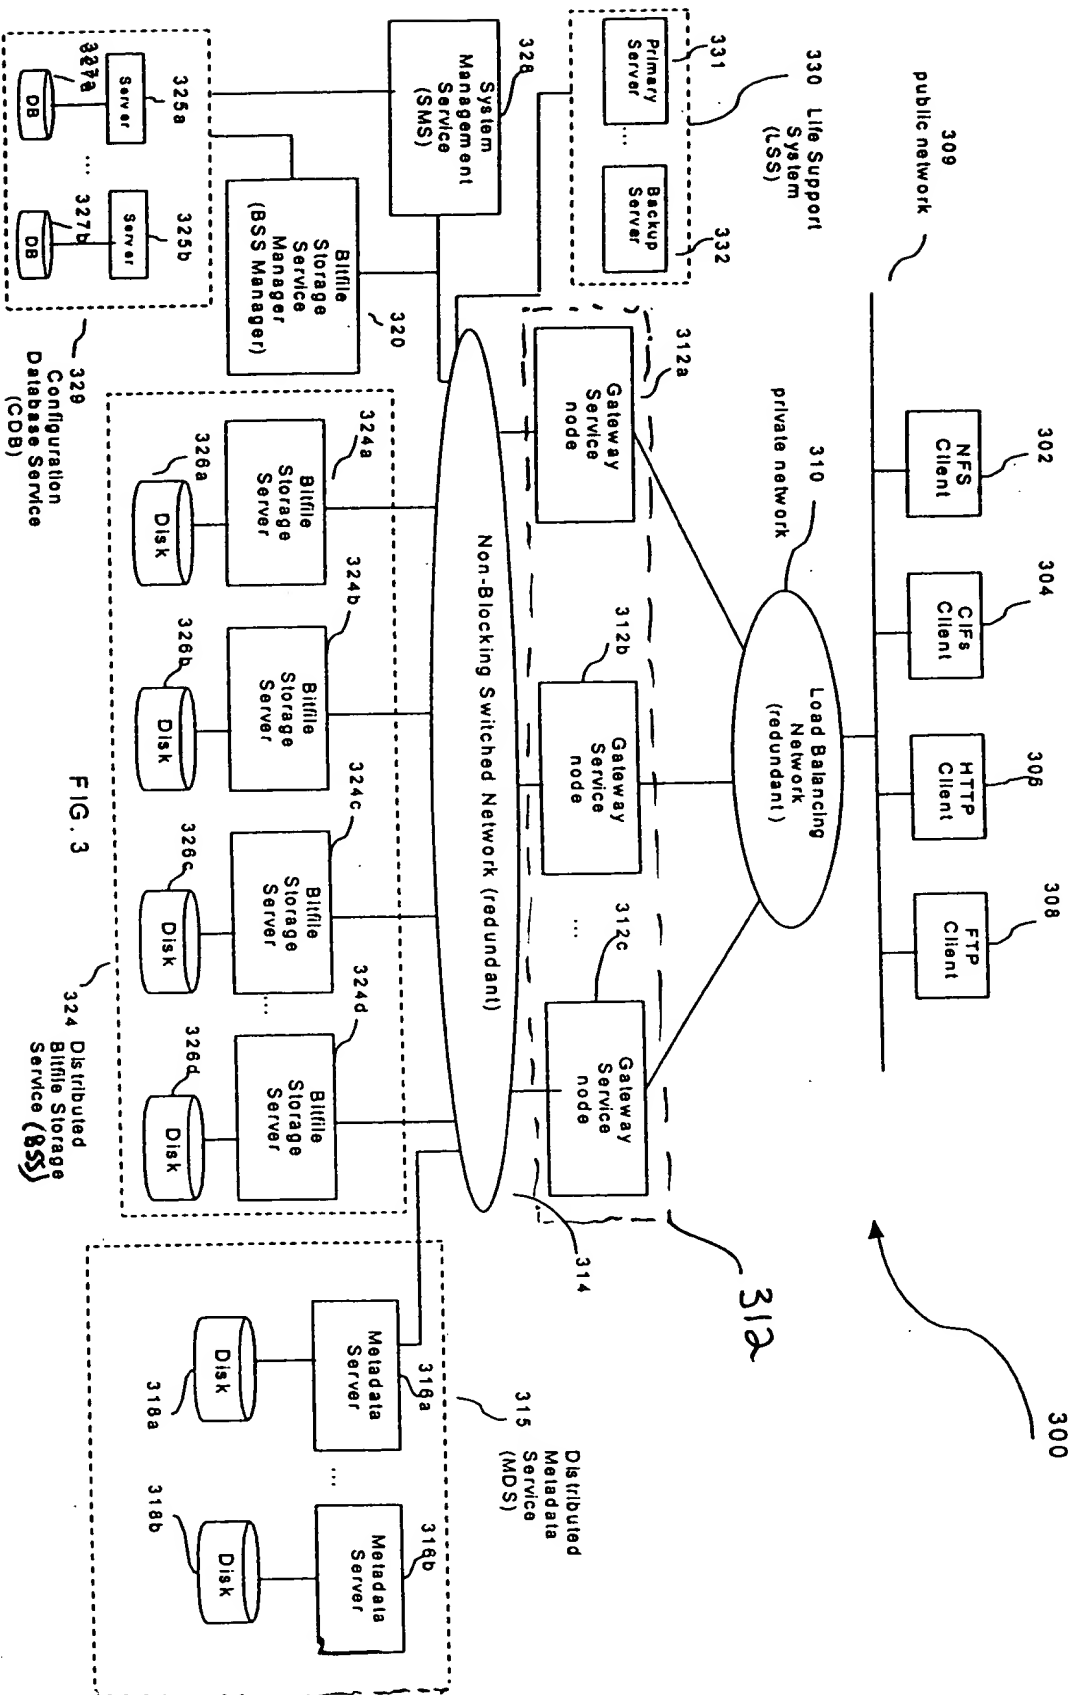


FIG. 3

09/731418

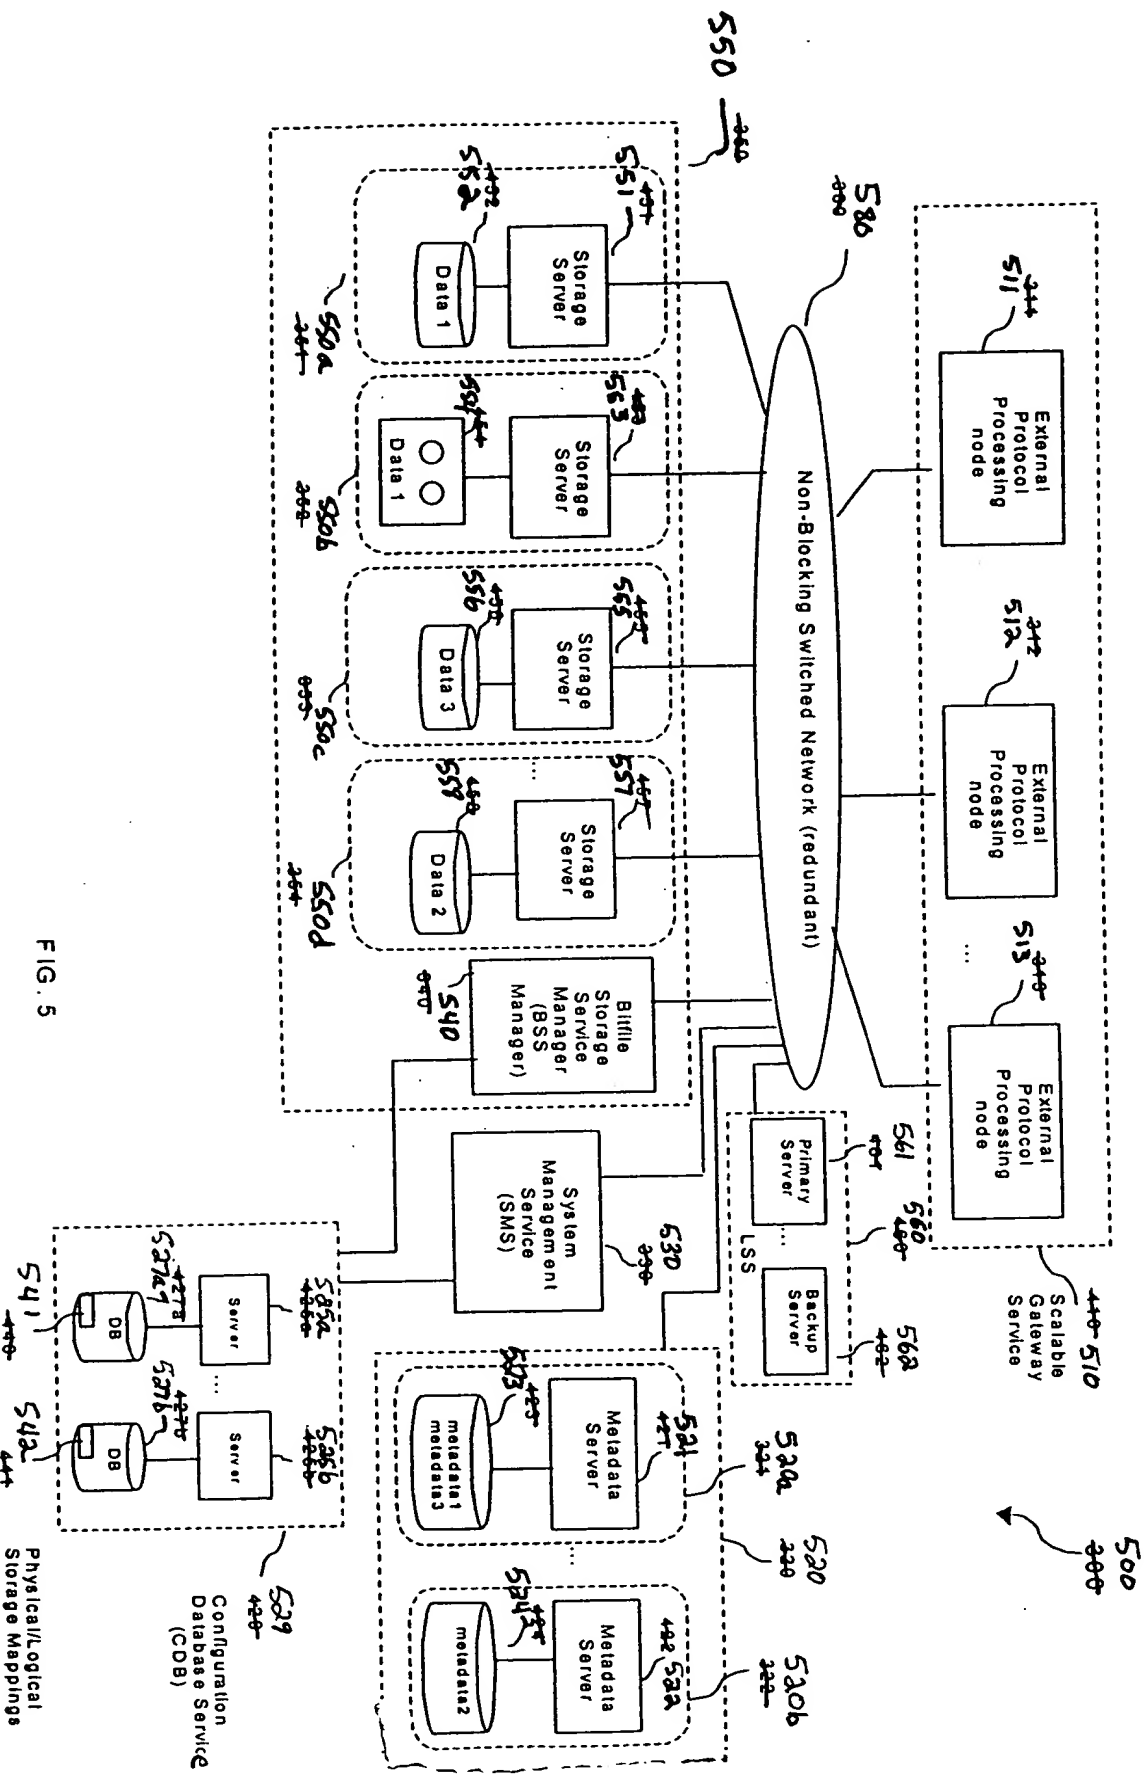


FIG. 5

09/73/418

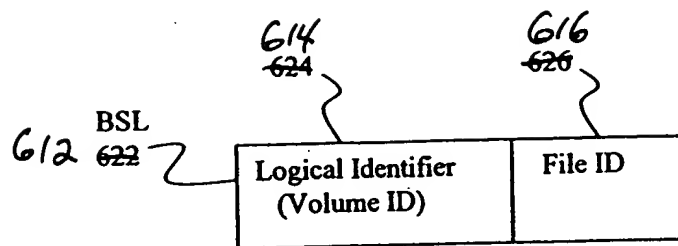


Table 632

Vol. ID	Mirrors
Vol. 0	Vol. 1, Vol. 2
⋮	⋮

Table 633

Logical Identifier	Physical Identifier
Vol. 1	(Server x, Device x)
Vol. 2	(Server y, Device y)
⋮	⋮

FIG. 6C

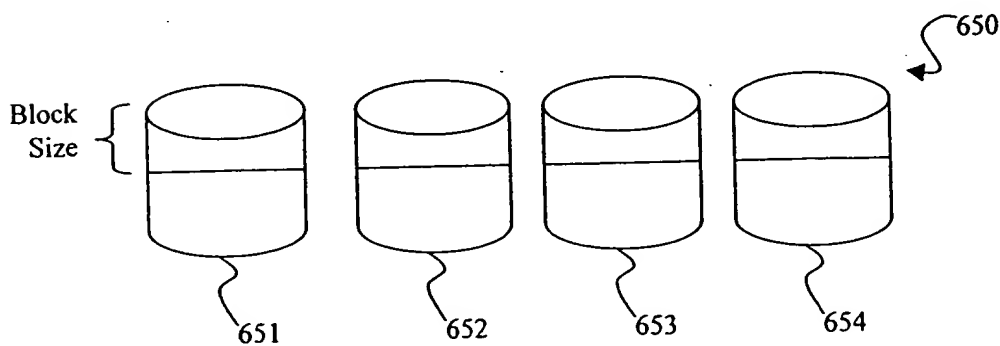
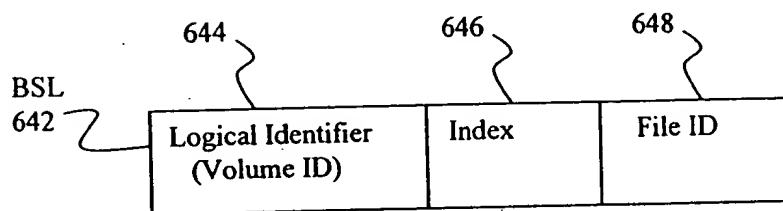


FIG. 6D

09/73/418

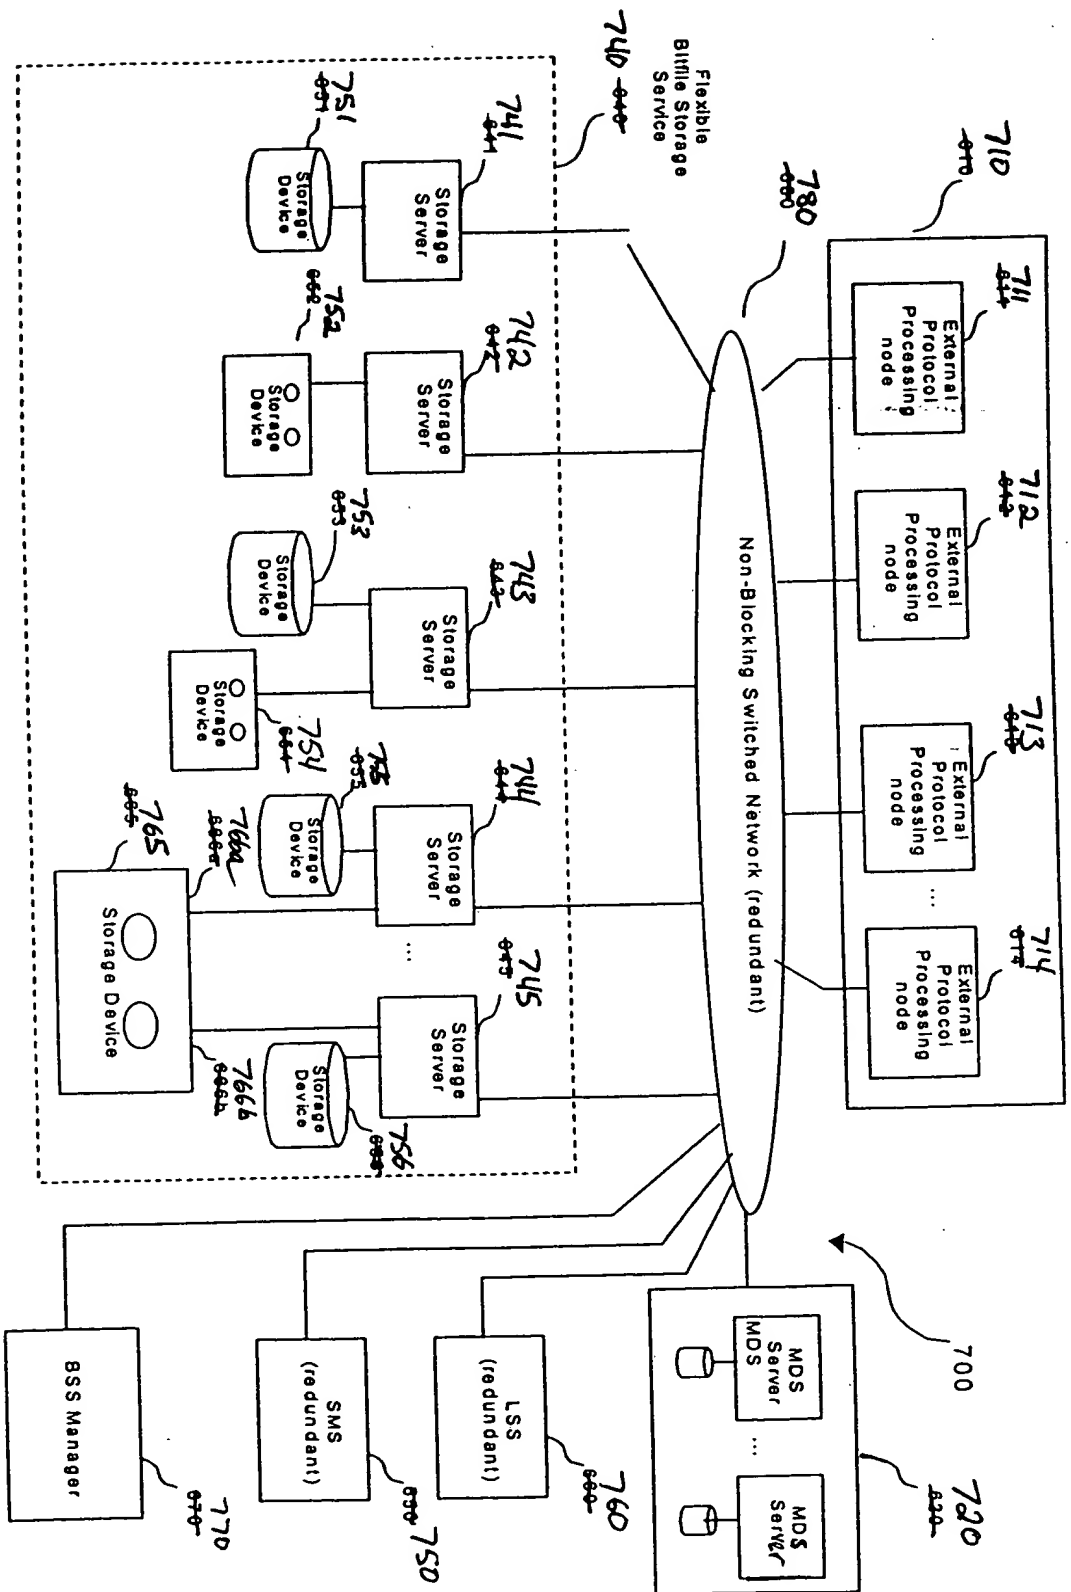


FIG. 7

09/73/418